







TEST & EVALUATION REPORT Shingle Rejuvenator Benchmark Life-Cycle Study

July 6, 2023

Report For: Roof Rejuvenate USA Shingles Rejuvenator Saskatchewan, Canada

Email: info@greenershinglesrejuvenator.com

Sample Data/Information:

SAMPLE ID	GRADE/TYPE	DATE SAMPLED	DATE RECEIVED	SOURCE
Aged Asphalt Shingles	Architectural – Post Consumer	*Note 1	9/15/22 R	Boofing Contractor
Shingle Rejuvenator	Roof Rejuvenate USA	9/2022		Roofing Contractor

*Shingles removed from a home in Crystal River, FL approximately 14 years after installation

OBJECTIVES:

Conduct a Benchmark Life-Cycle Study of Roof Rejuvenate USA Rejuvenator utilizing aged asphalt shingles that were removed from a home after approximately 14 years of exposure in Crystal River, Florida. Determine the estimated contribution to the shingles life-cycle made by the rejuvenator and quantify the differences to that of an untreated set of shingles.

The study used a miniature steep sloped roof, constructed at PRI made with commonly used stock material (2X4's, plywood, peel-n-stick underlayment, and stainless-steel roofing nails). Both slopes were roofed with the aged shingles, with one side being treated with Roof Rejuvenate USA rejuvenator and the other side being an un-treated roof deck. The rejuvenator was applied according the manufacturer's recommendations. See appendix for photos and details of construction

The miniature roof was weathered according to ASTM D4798 – "Standard Practice for Accelerated Weathering Test Conditions and Procedures for Bituminous Materials" using a modified exposure cycle consisting of, 51 minutes of light only and 9 minutes of light with rain. Studies have shown that 3000 Hours of APWS aging can be correlated to 10 years of normal outdoor exposure.

GSS 01-02-01

PRI Accreditation: AASHTO re:source; IAS-ES; ISO/IEC 17025:2017; CMEC; USACE

The test results, opinions, or interpretations are based on the material supplied by the client. This report is for the exclusive use of stated client. No reproduction or facsimile in any form can be made without the client's permission. PRI Asphalt Technologies, Inc. assumes no responsibility nor makes a performance or warranty statement for this material or products and processes containing this material in connection with this report. Not all tests listed may be covered by AMRL and/or AAP accreditations. PRI Asphalt Technologies, Inc. 6408 Badger Drive Tampa, FL 33610 • Tel: 813-621-5777 • Fax: 813-621-5840 • e-mail: sjoeffler@priasphalt.com • Website: www.pri-group.com









CONCLUSIONS: Primary Property Assessment

- **Mass Loss**: Mass loss in asphalt shingles is due to both the oxidative aging of the binder and granular loss during the accelerated weathering process.
 - After 1,500 hours of exposure the mass loss of the un-treated shingles was 5.4% compared to 0.5% for the Roof Rejuvenate USA rejuvenator.
 - Roof Rejuvenate USA Rejuvenator performs 10.8 times better than un-treated shingles
- **Wash off Material**: The exposure cycles consistently contained particulate material and shingle granules that were washed off by the accelerated weathering process.
 - After 1,500 hours of exposure the mass of the collected particulate from the un-treated shingles was 4.08g compared to 0.70g for the Roof Rejuvenate USA' rejuvenator.
 <u>Roof Rejuvenate USA Rejuvenator performs 5.8 times better than un-treated shingles</u>
- Oxidative Aging (Measured by Carbonyl Indices): Oxidative aging in asphalt-based products can be quantified by a peak in a specific position on an FT-IR spectrum.
 - After 1,500 hours of exposure the un-treated shingles exhibited a 30.7% increase in carbonyl index, compared to Greener Shingle's 7.8% increase.
 <u>Roof Rejuvenate USA Rejuvenator performs 3.9 times better than un-treated shingles</u>
- Shingle Flexibility: After 1,500 hours of exposure, Roof Rejuvenate USA Rejuvenator improved low temperature flexibility from -22°F to -31°F.
- Shingle Color and Appearance: After 1,500 hours of exposure, the shingles treated with Roof Rejuvenate USA Rejuvenator exhibit a significantly different appearance than those left untreated.
 - Un-treated shingles show a clear increase in the roofing granules lost. (Appendix A-4)

GSS 01-02-01

PRI Accreditation: AASHTO re:source; IAS-ES; ISO/IEC 17025:2017; CMEC; USACE

The test results, opinions, or interpretations are based on the material supplied by the client. This report is for the exclusive use of stated client. No reproduction or facsimile in any form can be made without the client's permission. PRI Asphalt Technologies, Inc. assumes no responsibility nor makes a performance or warranty statement for this material or products and processes containing this material in connection with this report. Not all test listed may be covered by AMRL and/or AAP accreditations. PRI Asphalt Technologies, Inc. 6408 Badger Drive Tampa, FL 33610 • Tel: 813-621-5777 • Fax: 813-621-5840 • e-mail: gloeffler@priasphalt.com • Website: www.pri-group.com










APPENDIX

APPENDIX A-3 (PRI – Asphalt Pavement Weathering System):

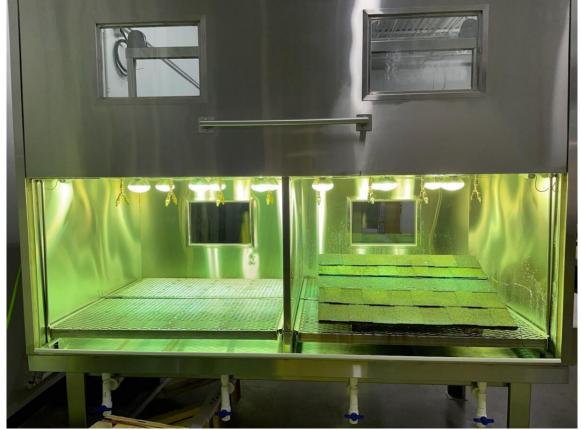

DISCUSSION:

An open view of PRI's Asphalt Pavement Weathering System with the roof deck positioned in the front chamber (right).

PRI's APWS was used for accelerated weathering of the roof deck after the application and curing of the rejuvenators. The weatherometer is monitored daily for even light distribution and water spray coverage, while temperature of the chamber, roof surface, water, ambient temperature and relative humidity are all tracked continuously.

ACCELERATED AGING PARAMETERS:

PARAMETER	SETTING		
APWS Cycle and Climate Information			
Cycle Reference Method	ASTM D4798, Cycle A		
Time of UV Light Exposure, mins	51		
Time of UV Exposure with Rain Cycle, mins	9		
Average Maximum Shingle Temperature, °F (Note 1)	149.5		
Average "Rain Rate", gal/hr	12.6		

Note 1 – Average Maximum Shingle Temperature is measured by taking the average of the temperature readings immediately before the beginning of the "rain cycle" when the temperature is at its highest level.

GSS 01-02-01 PRI Accreditation: AASHTO re:source; IAS-ES; ISO/IEC 17025:2017; CMEC; USACE The test results, opinions, or interpretations are based on the material supplied by the client. This report is for the exclusive use of stated client. No reproduction or facsimile in any form can be made without the client's permission. PRI Asphalt Technologies, Inc. assumes no responsibility nor makes a performance or warranty statement for this material or products and processes containing this material in connection with this report. Not all tests listed may be covered by AMRL and/or AAP accreditations. PRI Asphalt Technologies, Inc. 6408 Badger Drive Tampa, FL 33610 • Tel: 813-621-5777 • Fax: 813-621-5840 • e-mail: sloeffler@priasphalt.com • Website: www.pri-group.com








17025 Roof Rejuvenate USA Rejuvenator Shingle Rejuvenator Study July 6, 2023 Page 8 of 13

APPENDIX

APPENDIX A-4 (Shingle Appearance Comparison – ~1500 hours):

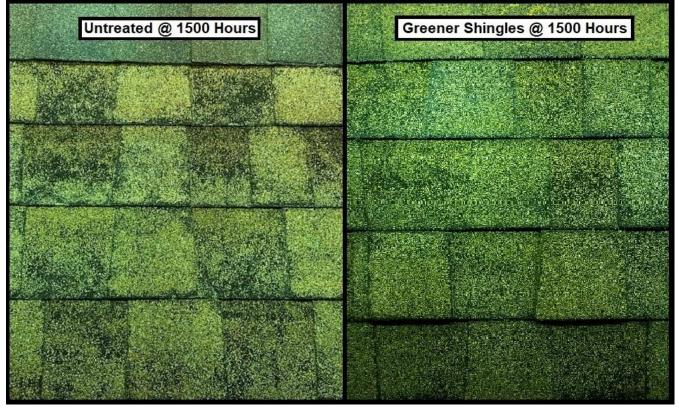

DISCUSSION:

There is a notable difference in appearance between the untreated and treated shingles after 1500 Hours.

PRI Accreditation: AASHTO re:source; IAS-ES; ISO/IEC 17025:2017; CMEC; USACE

The test results, opinions, or interpretations are based on the material supplied by the client. This report is for the exclusive use of stated client. No reproduction or facsimile in any form can be made without the client's permission. PRI Asphalt Technologies, Inc. assumes no responsibility nor makes a performance or warranty statement for this material or products and processes containing this material in connection with this report. Not all tests listed may be covered by AMRL and/or AAP accreditations. PRI Asphalt Technologies, Inc. 6408 Badger Drive Tampa, FL 33610 • Tel: 813-621-5777 • Fax: 813-621-5840 • e-mail: sjoeffler@priasphalt.com • Website: www.pri-group.com








Traverbaumber Roof Rejuvenate USA Rejuvenator Shingle Rejuvenator Study July 6, 2023 Page 10 of 13

APPENDIX

APPENDIX A-6 (Granular Wash off Comparison – ~1500 hours):

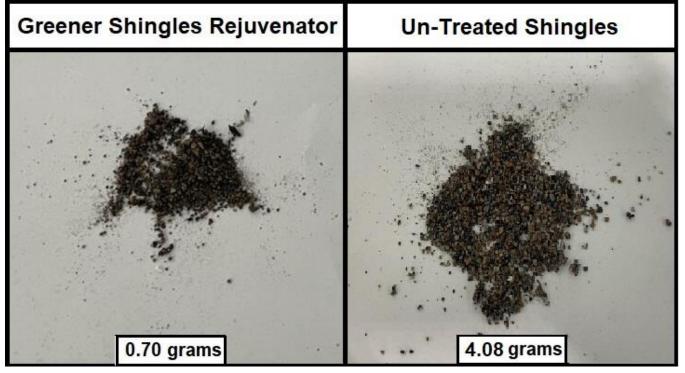

DISCUSSION:

Granules and particulate washed from the roof decks after 1500 hours of exposure. Particles have been filtered from the accompanying runoff water and dried for quantification.

PRI Accreditation: AASHTO re:source; IAS-ES; ISO/IEC 17025:2017; CMEC; USACE

The test results, opinions, or interpretations are based on the material supplied by the client. This report is for the exclusive use of stated client. No reproduction or facsimile in any form can be made without the client's permission. PRI Asphalt Technologies, Inc. assumes no responsibility nor makes a performance or warranty statement for this material or products and processes containing this material in connection with this report. Not all tests listed may be covered by AMRL and/or AAP accreditations. PRI Asphalt Technologies, Inc. 6408 Badger Drive Tampa, FL 33610 • Tel: 813-621-5777 • Fax: 813-621-5840 • e-mail: sloeffler@priasphalt.com • Website: www.pri-group.com







Fre AL STITU A constants: Progen Roof Rejuvenator Shingle Rejuvenator Study July 6, 2023 Page 4 of 13

NEXT STEPS:

- Complete 3000 Hours of Aging and subsequent testing.
- Review with Roof Rejuvenate USA.

Gray & Lo

Tested by:

Greg Lavin, Laboratory Technician

Reported by:

Steven Loeffler, Client Services Manager

Date: July 6, 2023

Date: July 6, 2023

GSS 01-02-01

PRI Accreditation: AASHTO re:source; IAS-ES; ISO/IEC 17025:2017; CMEC; USACE

The test results, opinions, or interpretations are based on the material supplied by the client. This report is for the exclusive use of stated client. No reproduction or facsimile in any form can be made without the client's permission. PRI Asphalt Technologies, Inc. assumes no responsibility nor makes a performance or warranty statement for this material or products and processes containing this material in connection with this report. Not all tests listed may be covered by AMRL and/or AAP accreditations. PRI Asphalt Technologies, Inc. 6408 Badger Drive Tampa, FL 33610 • Tel: 813-621-5777 • Fax: 813-621-5840 • e-mail: sloeffler@priasphalt.com • Website: www.pri-group.com